


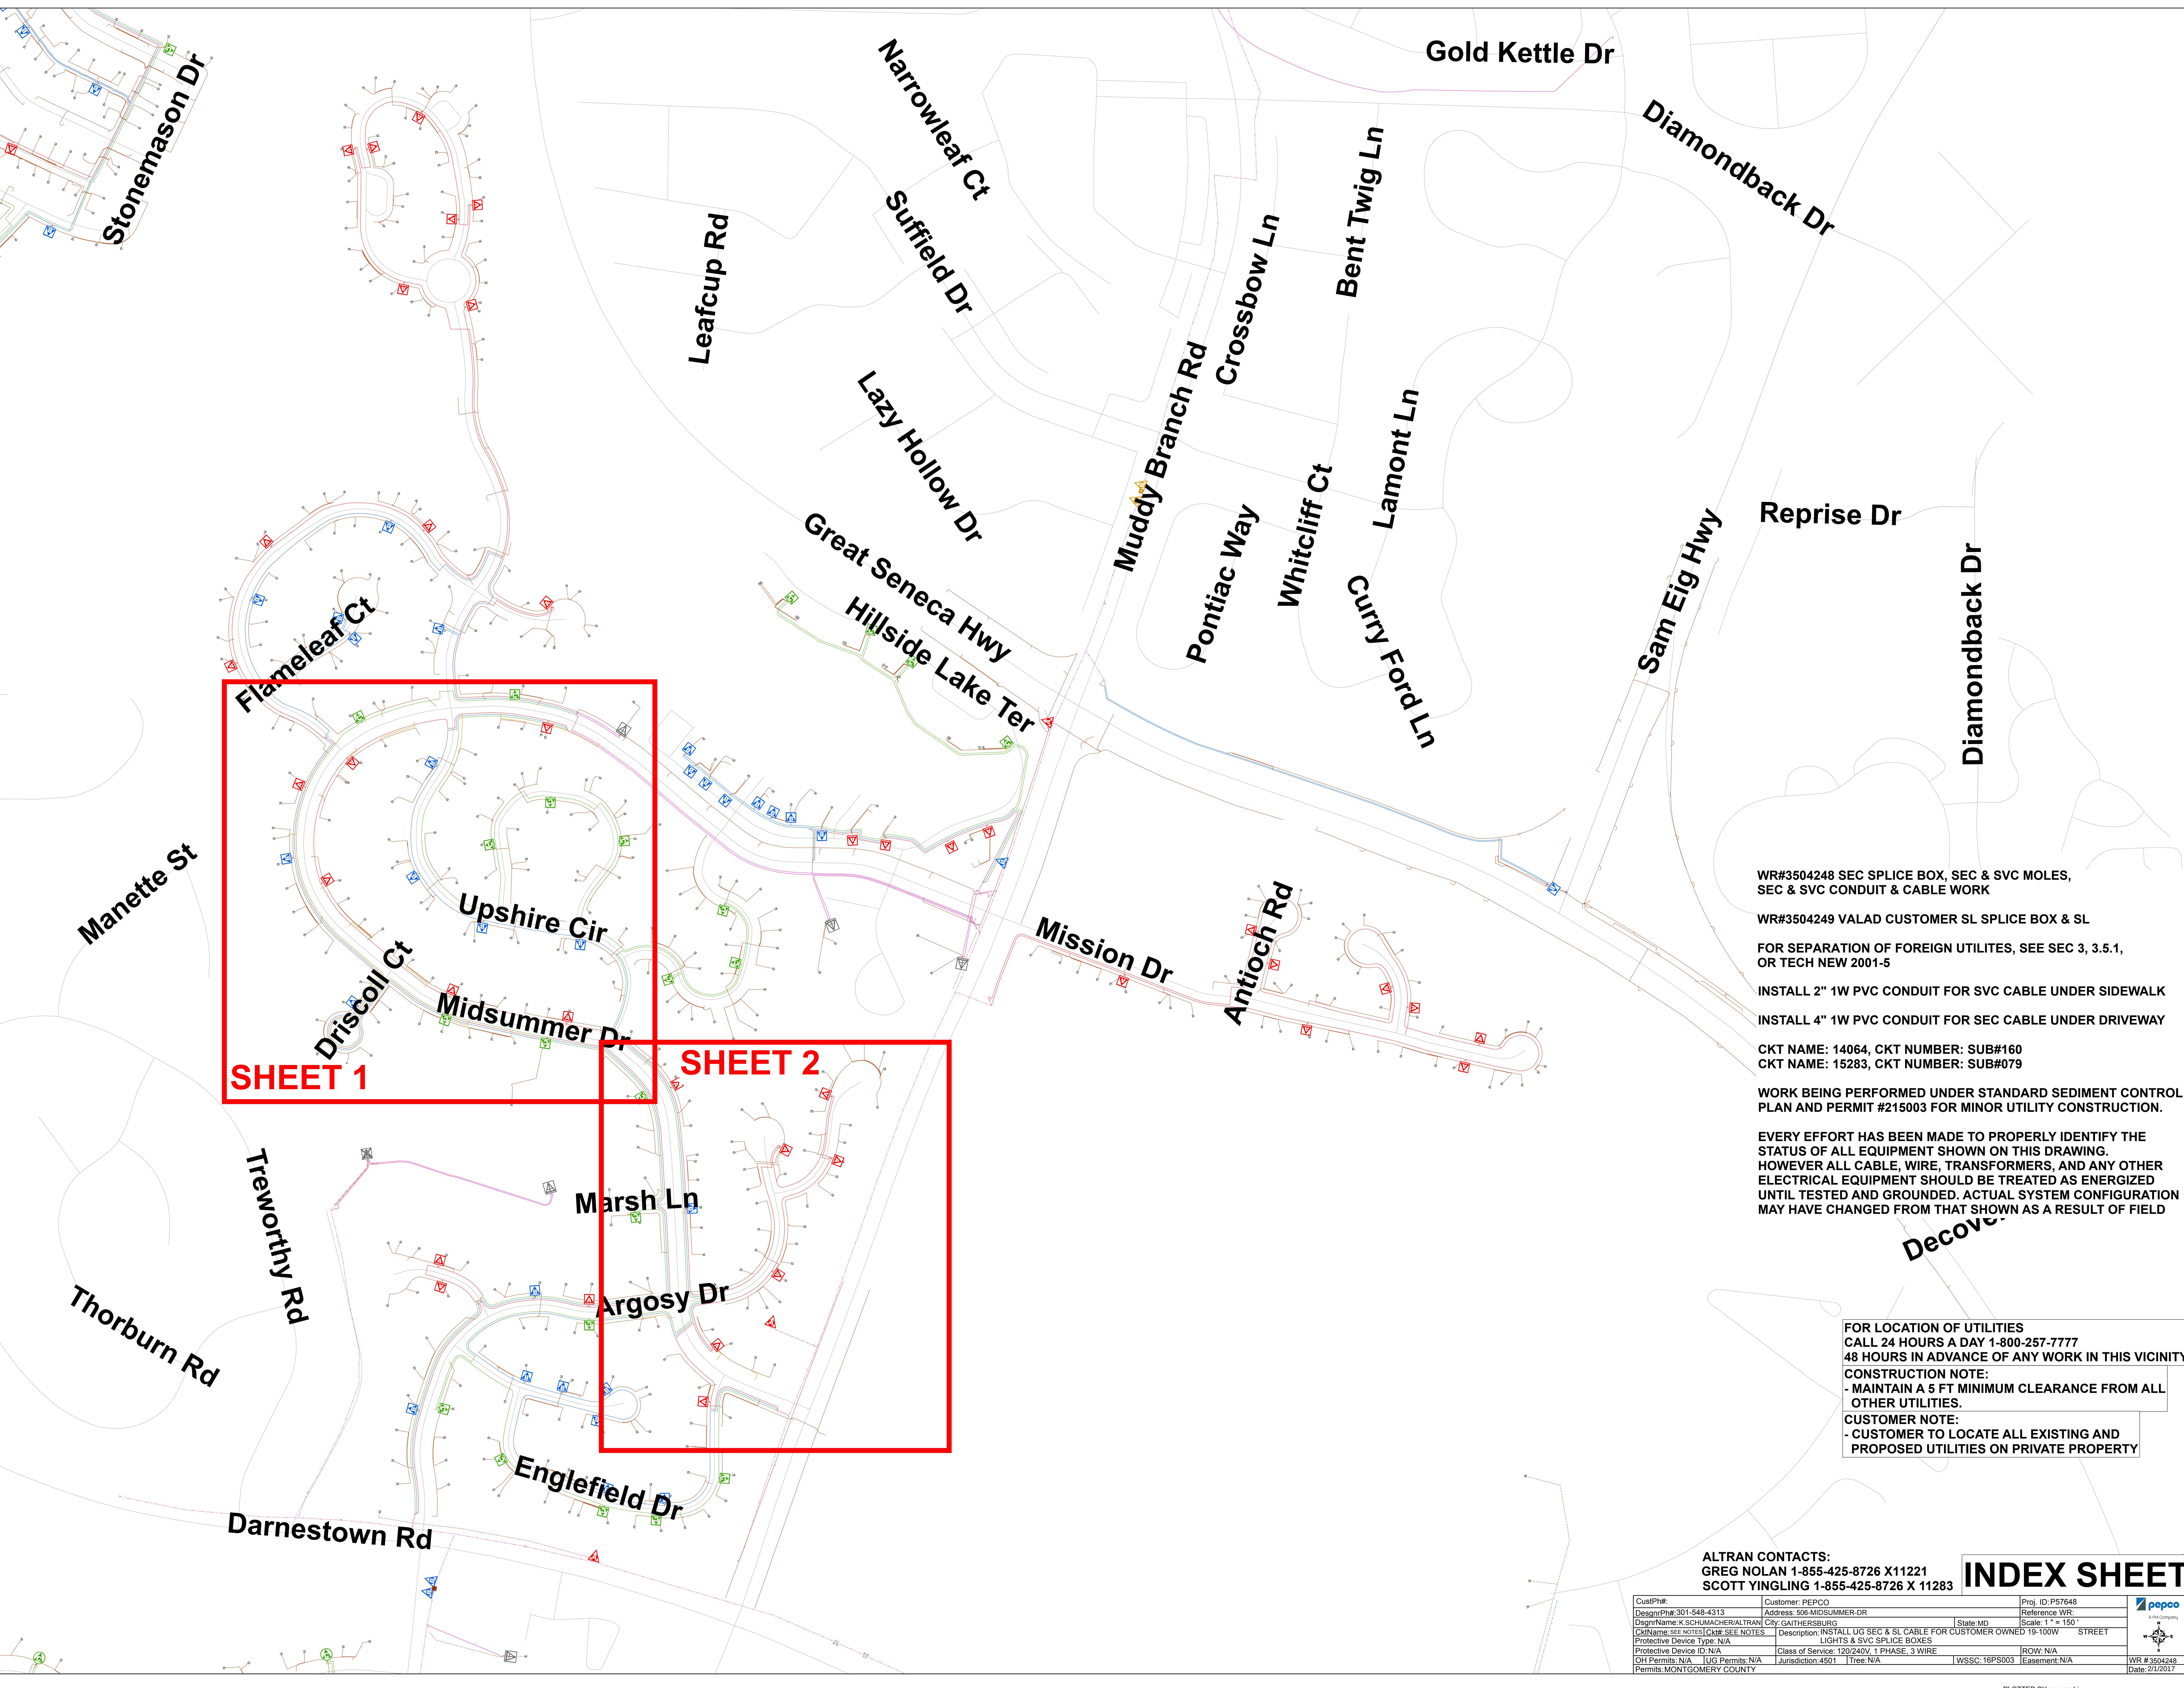

WR#3504248 SEC SPLICE BOX, SEC & SVC MOLES,
SEC & SVC CONDUIT & CABLE WORK

WR#3504249 VALAD CUSTOMER SL SPLICE BOX & SL

FOR SEPARATION OF FOREIGN UTILITES, SEE SEC 3, 3.5.1,
OR TECH NEW 2001-5

INSTALL 2" 1W PVC CONDUIT FOR SVC CABLE UNDER SIDEWALK

INSTALL 4" 1W PVC CONDUIT FOR SEC CABLE UNDER DRIVEWAY

CKT NAME: 14064, CKT NUMBER: SUB#160
CKT NAME: 15283, CKT NUMBER: SUB#079

WORK BEING PERFORMED UNDER STANDARD SEDIMENT CONTROL
PLAN AND PERMIT #215003 FOR MINOR UTILITY CONSTRUCTION.

EVERY EFFORT HAS BEEN MADE TO PROPERLY IDENTIFY THE
STATUS OF ALL EQUIPMENT SHOWN ON THIS DRAWING.
HOWEVER ALL CABLE, WIRE, TRANSFORMERS, AND ANY OTHER
ELECTRICAL EQUIPMENT SHOULD BE TREATED AS ENERGIZED
UNTIL TESTED AND GROUNDED. ACTUAL SYSTEM CONFIGURATION
MAY HAVE CHANGED FROM THAT SHOWN AS A RESULT OF FIELD

FOR LOCATION OF UTILITIES
CALL 24 HOURS A DAY 1-800-257-7777
48 HOURS IN ADVANCE OF ANY WORK IN THIS VICINITY


CONSTRUCTION NOTE:
- MAINTAIN A 5 FT MINIMUM CLEARANCE FROM ALL
OTHER UTILITIES.

CUSTOMER NOTE:
- CUSTOMER TO LOCATE ALL EXISTING AND
PROPOSED UTILITIES ON PRIVATE PROPERTY

ALTRAN CONTACTS:
GREG NOLAN 1-855-425-8726 X11221
SCOTT YINGLING 1-855-425-8726 X 11283

INDEX SHEET

CustP#:		Customer: PEPCO		Proj. ID: P57648		 A GEC Company
DesignP#:		Address: 506-MIDSUMMER-DR		Reference WR:		
DesignName:		K.SCHUMACHER/ALTRAN		City: GAITHERSBURG		
				State: MD		
				Scale: 1" = 150'		
CKTName: SEE NOTES		CKT#: SEE NOTES		Description: INSTALL UG SEC & SL CABLE FOR CUSTOMER OWNED 19-100W STREET		
Protective Device Type: N/A				LIGHTS & SVC SPLICE BOXES		
Protective Device ID: N/A		Class of Service: 120/240V, 1 PHASE, 3 WIRE		ROW: N/A		
OH Permits: N/A		UG Permits: N/A		Jurisdiction: 4501		
Permits: MONTGOMERY COUNTY		Tree: N/A		WSSC: 16PS003		
				Easement: N/A		WR # 3504248
						Date: 2/1/2017

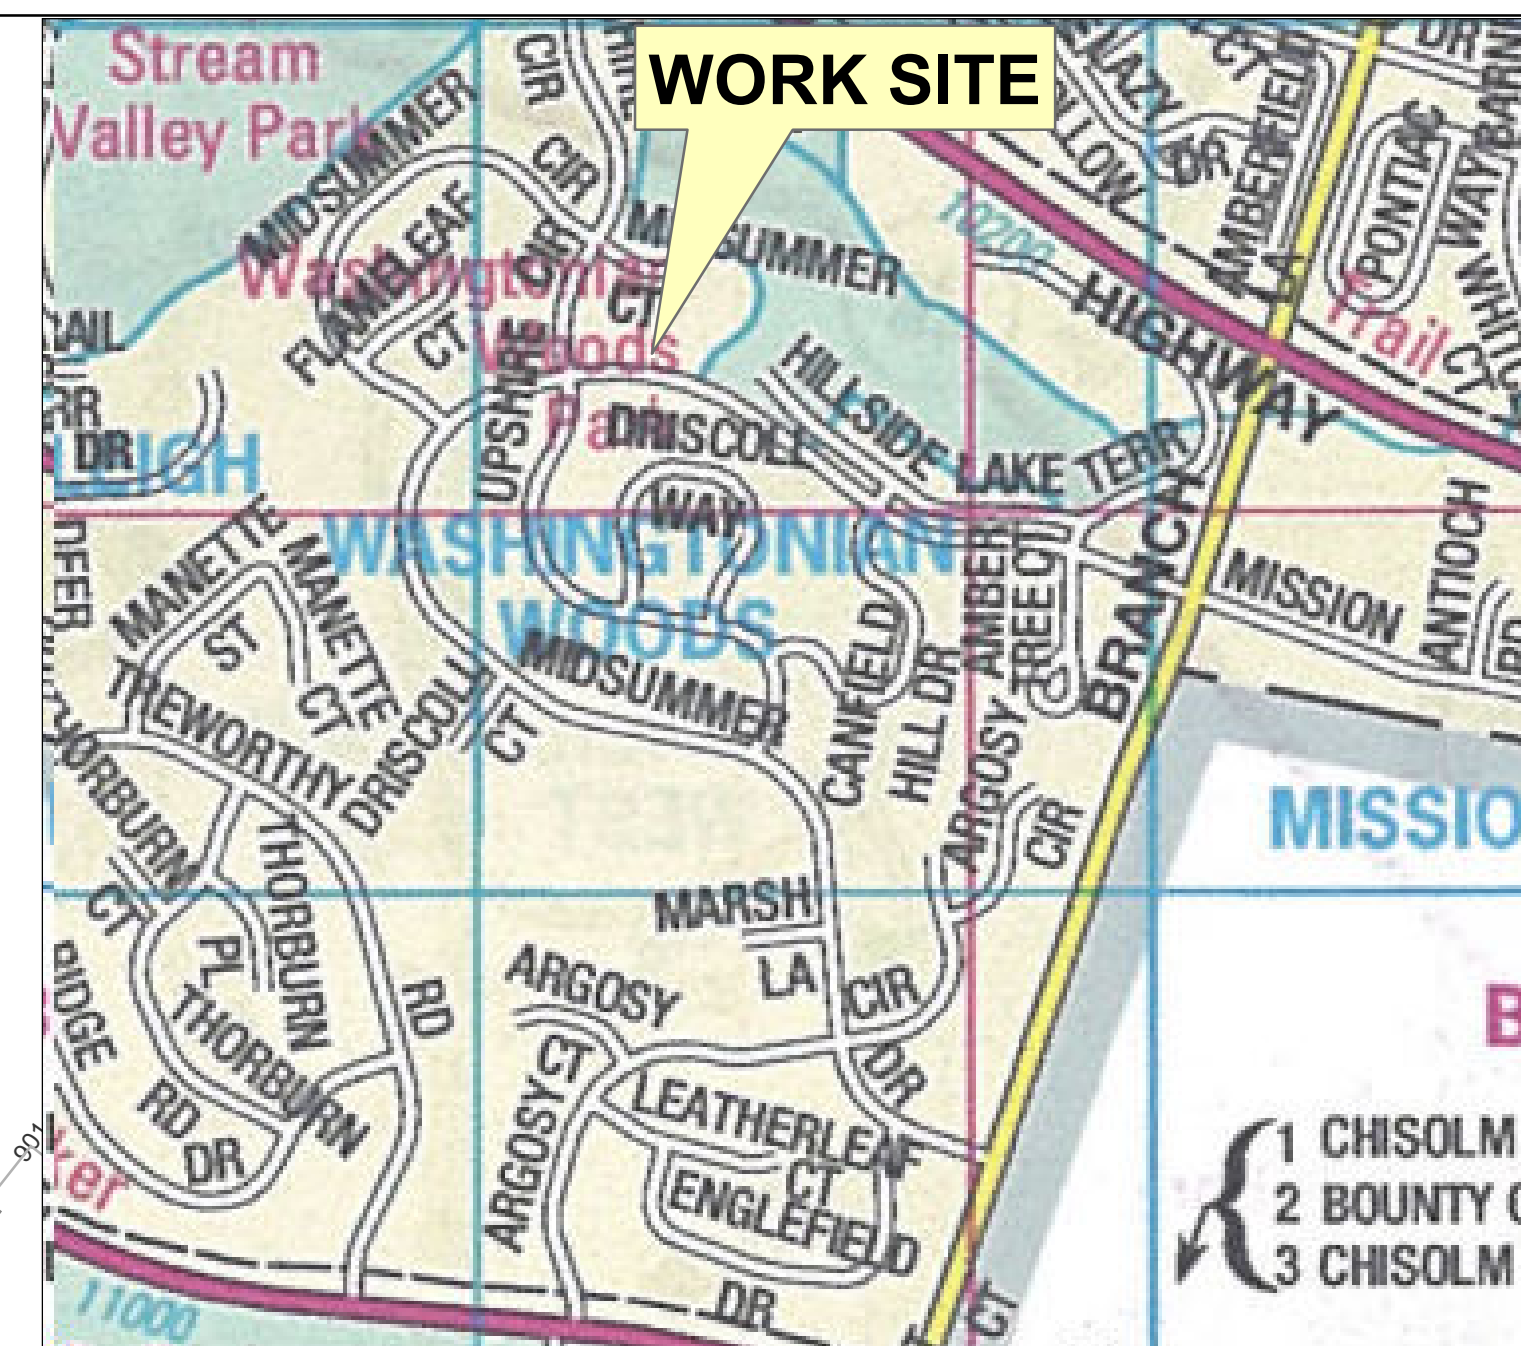

VICINITY MAP MC ADC PAGE 5163 - E3
COPYRIGHT ADC THE MAP PEOPLE
PERMITTED USE NO. 30911193

WR 3504248 SEC SPLICE BOX, SEC & SVC MOLES,
CONDUIT, & CABLE WORK

WR 3504249 VALAD CUSTOMER SL SPLICE BOX & SL

FOR SEPARATION OF FOREIGN UTILITES, SEE SEC 3, 3.5.1,
OR TECH NEW 2001-5

INSTALL 2" 1W PVC CONDUIT FOR SVC CABLE UNDER SIDEWALK

INSTALL 4" 1W PVC CONDUIT FOR SEC CABLE UNDER DRIVEWAY

CKT NAME: 14064, CKT NUMBER: SUB 160
CKT NAME: 15283, CKT NUMBER: SUB 079

WORK BEING PERFORMED UNDER STANDARD SEDIMENT CONTROL
PLAN AND PERMIT #215003 FOR MINOR UTILITY CONSTRUCTION.

EVERY EFFORT HAS BEEN MADE TO PROPERLY IDENTIFY THE
STATUS OF ALL EQUIPMENT SHOWN ON THIS DRAWING.
HOWEVER ALL CABLE, WIRE, TRANSFORMERS, AND ANY OTHER
ELECTRICAL EQUIPMENT SHOULD BE TREATED AS ENERGIZED
UNTIL TESTED AND GROUNDED. ACTUAL SYSTEM CONFIGURATION
MAY HAVE CHANGED FROM THAT SHOWN AS A RESULT OF FIELD
SWITCHING.

FOR LOCATION OF UTILITIES
CALL 24 HOURS A DAY 1-800-257-7777
48 HOURS IN ADVANCE OF ANY WORK IN THIS VICINITY
CONSTRUCTION NOTE:
- MAINTAIN A 5 FT MINIMUM CLEARANCE FROM ALL
OTHER UTILITIES.
CUSTOMER NOTE:
- CUSTOMER TO LOCATE ALL EXISTING AND
PROPOSED UTILITIES ON PRIVATE PROPERTY


ALTRAN CONTACTS:
GREG NOLAN 1-855-425-8726 X11221
SCOTT YINGLING 1-855-425-8726 X 11283

SHEET 1 OF 2


Customer: PEPCO	Proj. ID: P57648	 A NRG COMPANY			
Design/Ph#: 301-548-4313	Address: 506 MIDSUMMER DR		Reference: WR:		
Design/Name: K. SCHUMACHER/ALTRAN	City: GAITHERSBURG		State: MD	Scale: 1" = 40'	
City/Name: SEE NOTES	Description: INSTALL UG SEC & SL CABLE FOR CUSTOMER OWNED 19-100W STREET LIGHTS & SVC SPLICE BOXES				
Protective Device Type: N/A					
Protective Device ID: N/A	Class of Service: 120/240V, 1 PHASE, 3 WIRE	ROW: N/A			
OH Permits: N/A	Jurisdiction: 4501	Tree: N/A	WSSC: 16PS003	Easement: N/A	WR # 3504248
Permits: MONTGOMERY COUNTY					Date: 2/1/2017

A SEE SHEET 2 A

PLOTTED BY: dilaaj

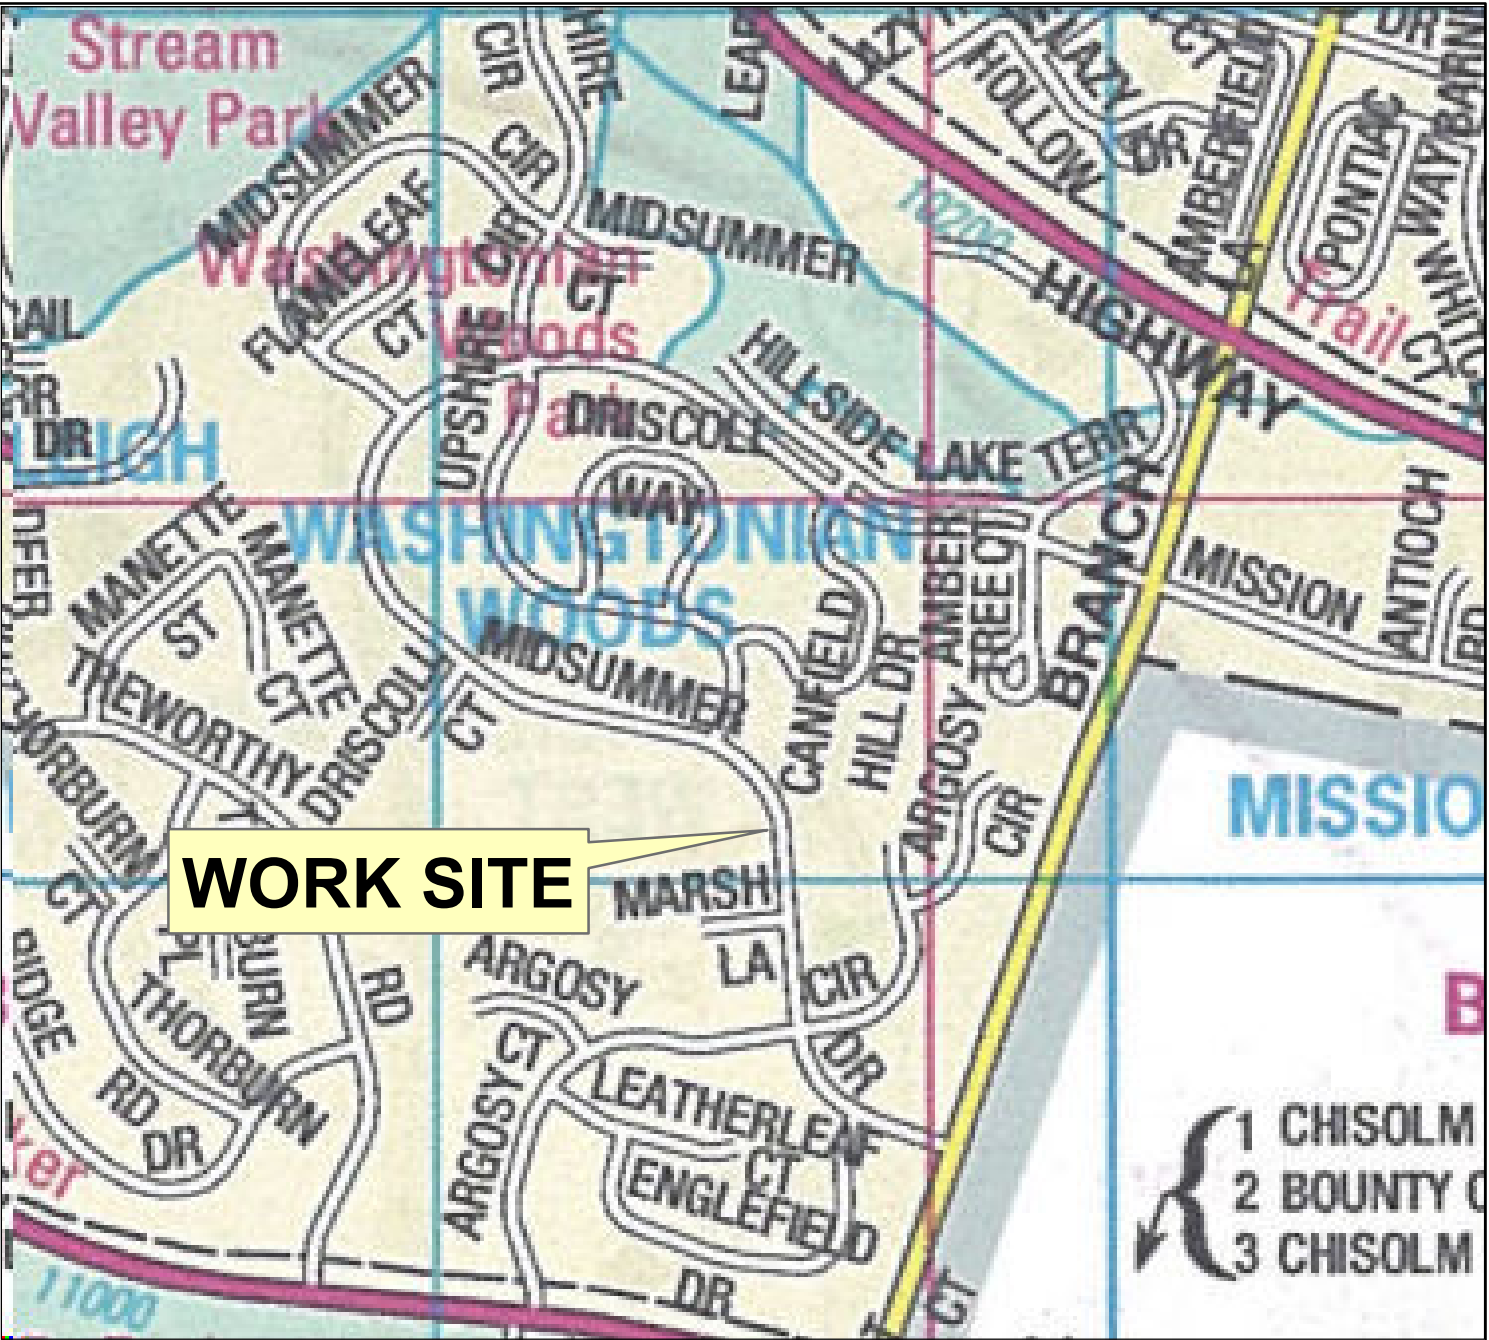

VICINITY MAP MC ADC PAGE 5163 - E3
COPYRIGHT ADC THE MAP PEOPLE
PERMITTED USE NO. 30911193

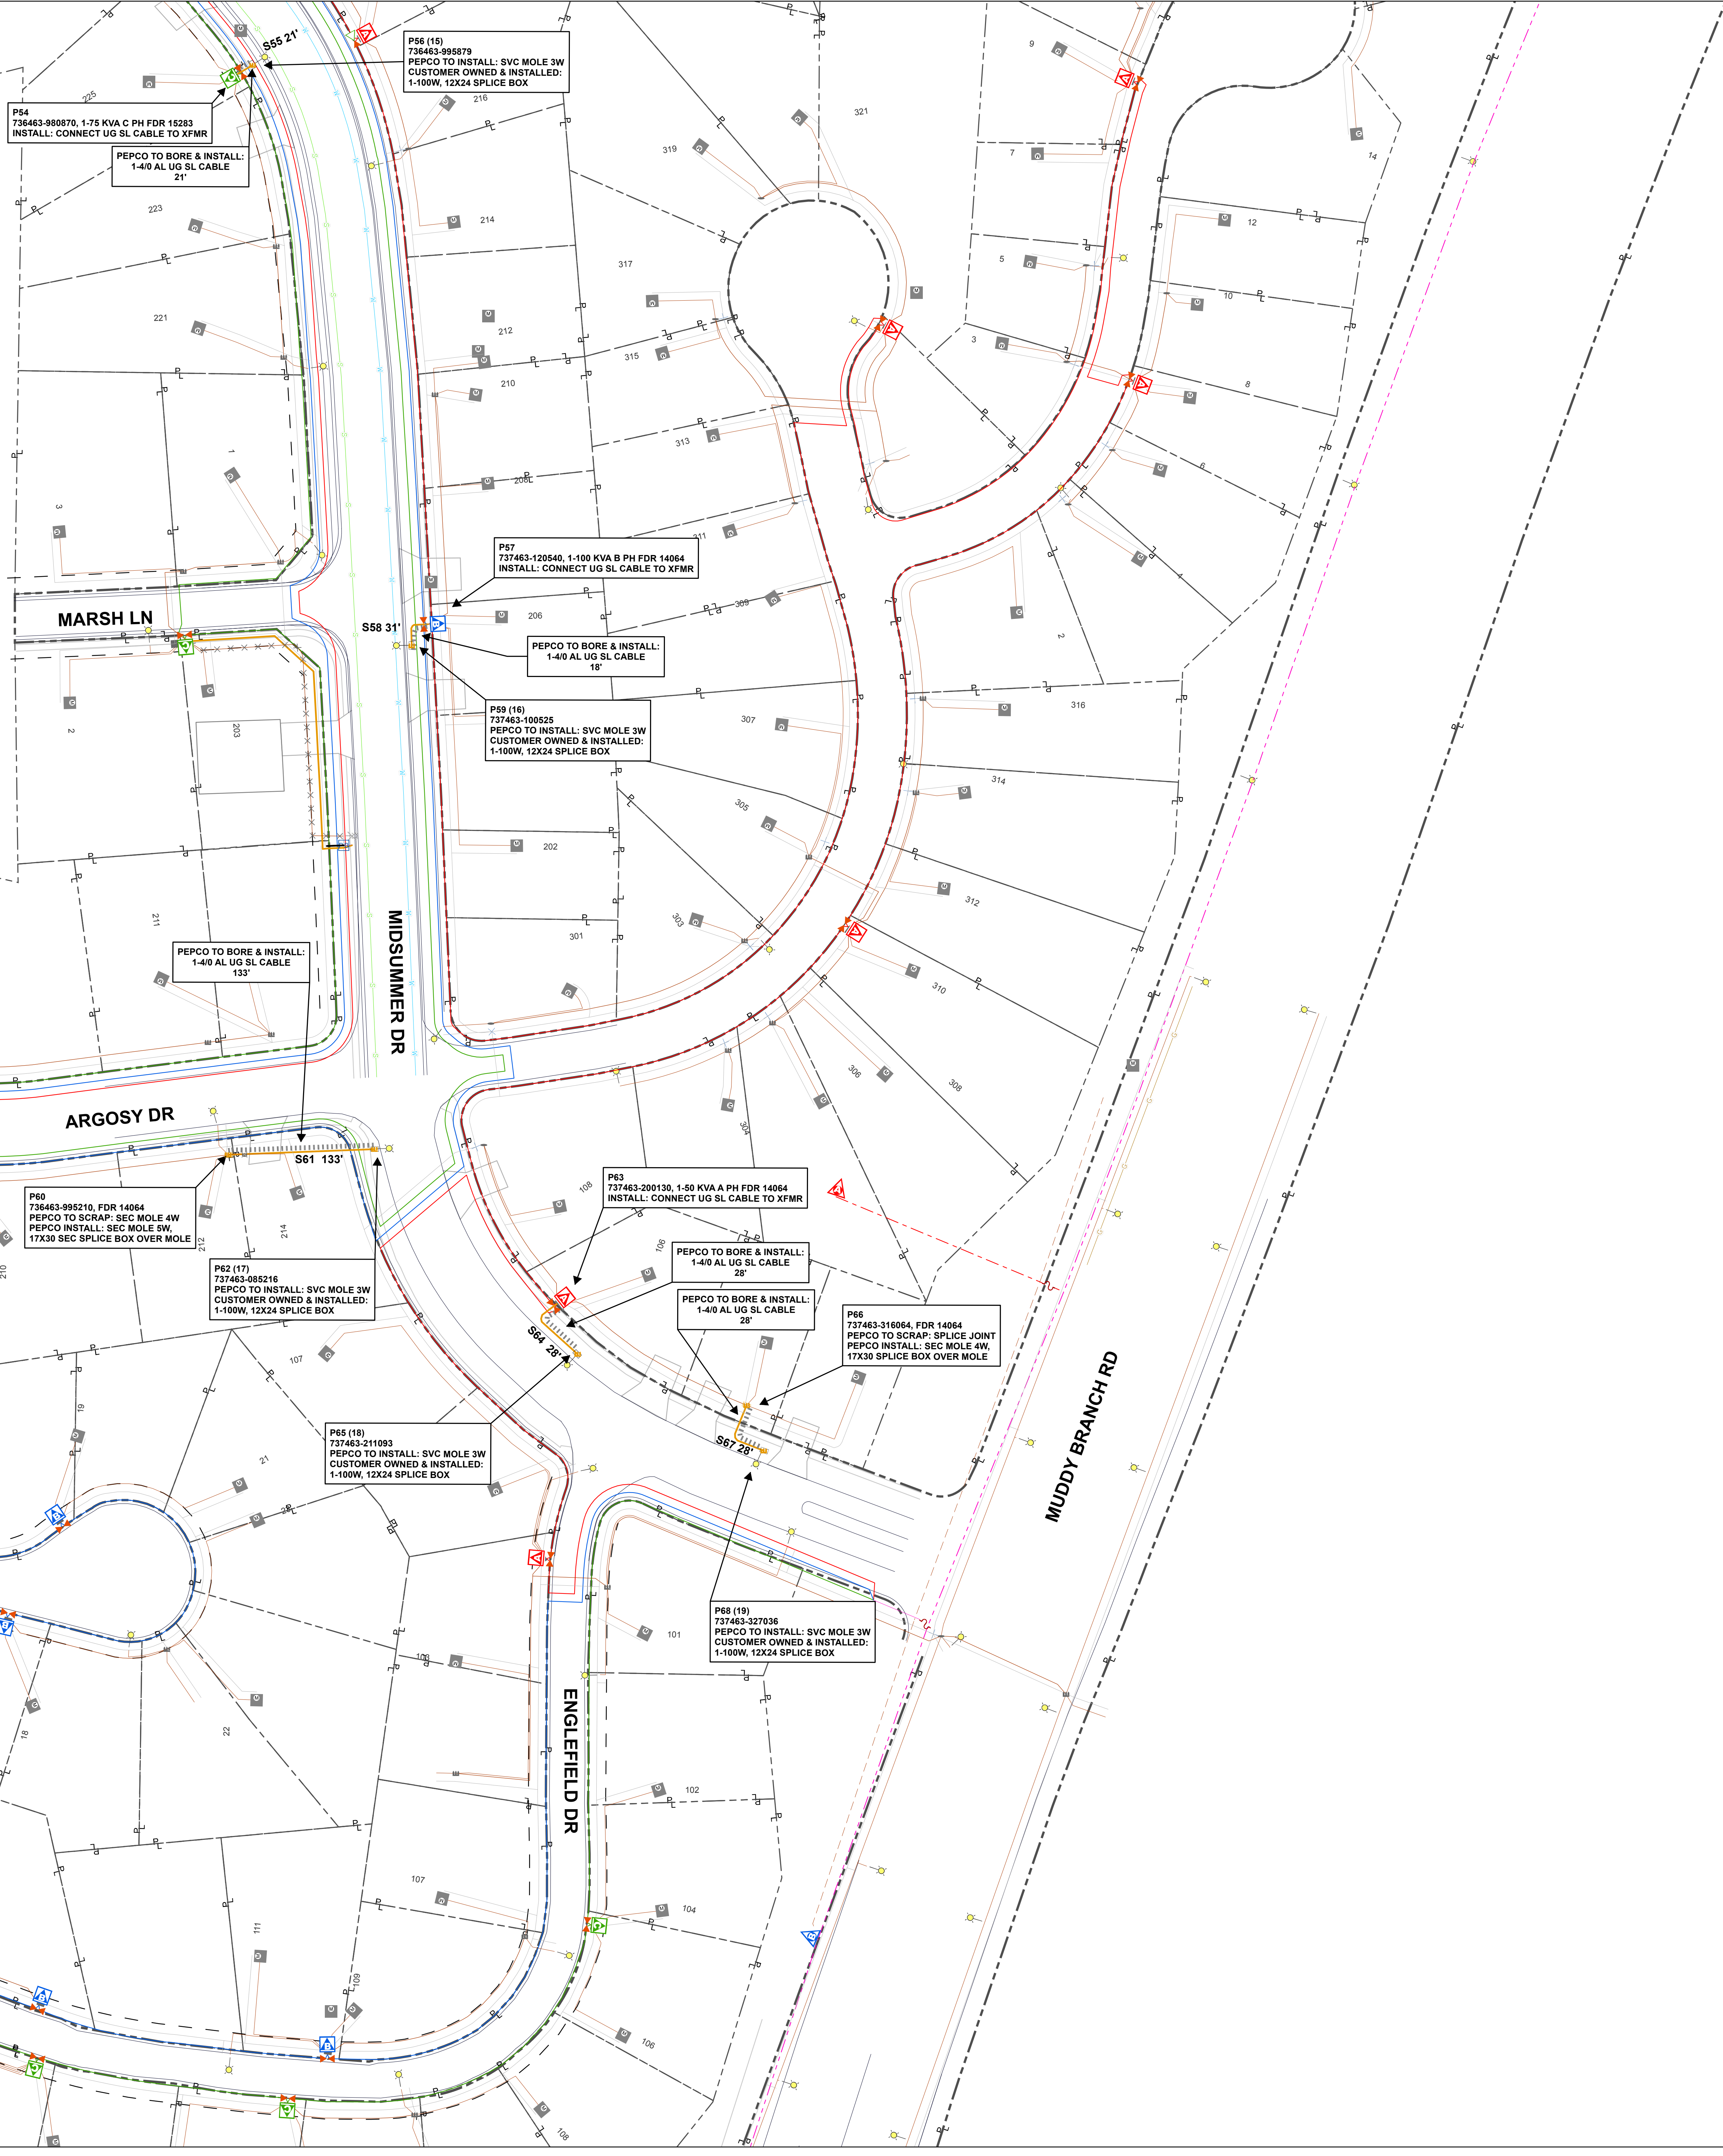

WR 3504248 SEC SPLICE BOX, SEC & SVC MOLES,
CONDUIT, & CABLE WORK

WR 3504249 VALAD CUSTOMER SL SPLICE BOX & SL

FOR SEPARATION OF FOREIGN UTILITES, SEE SEC 3, 3.5.1,
OR TECH NEW 2001-5

INSTALL 2" 1W PVC CONDUIT FOR SVC CABLE UNDER SIDEWALK

INSTALL 4" 1W PVC CONDUIT FOR SEC CABLE UNDER DRIVEWAY

CKT NAME: 14064, CKT NUMBER: SUB 160
CKT NAME: 15283, CKT NUMBER: SUB 079

WORK BEING PERFORMED UNDER STANDARD SEDIMENT CONTROL
PLAN AND PERMIT #215003 FOR MINOR UTILITY CONSTRUCTION.

EVERY EFFORT HAS BEEN MADE TO PROPERLY IDENTIFY THE
STATUS OF ALL EQUIPMENT SHOWN ON THIS DRAWING.
HOWEVER ALL CABLE, WIRE, TRANSFORMERS, AND ANY OTHER
ELECTRICAL EQUIPMENT SHOULD BE TREATED AS ENERGIZED
UNTIL TESTED AND GROUNDED. ACTUAL SYSTEM CONFIGURATION
MAY HAVE CHANGED FROM THAT SHOWN AS A RESULT OF FIELD
SWITCHING.

FOR LOCATION OF UTILITIES
CALL 24 HOURS A DAY 1-800-257-7777
48 HOURS IN ADVANCE OF ANY WORK IN THIS VICINITY
CONSTRUCTION NOTE:
- MAINTAIN A 5 FT MINIMUM CLEARANCE FROM ALL
OTHER UTILITIES.
CUSTOMER NOTE:
- CUSTOMER TO LOCATE ALL EXISTING AND
PROPOSED UTILITIES ON PRIVATE PROPERTY

ALTRAN CONTACTS:
GREG NOLAN 1-855-425-8726 X11221
SCOTT YINGLING 1-855-425-8726 X 11283

SHEET 2 OF 2

CustP#:	Customer: PEPSCO	Proj. ID: P57648
DesignP#:	Address: 506-MIDSUMMER-DR	Reference WR:
DsgnName:	K. SCHUMACHER/ALTRAN	City: GAITHERSBURG
City:	GAITHERSBURG	State: MD
Scale:	1" = 40'	STREET
ChName:	SEE NOTES	Description: INSTALL UG SEC & SL CABLE FOR CUSTOMER OWNED 19-100W
Protective Device Type:	N/A	LIGHTS & SVC SPLICE BOXES
Protective Device ID:	N/A	Class of Service: 120/240V, 1 PHASE, 3 WIRE
OH Permits:	N/A	U/G Permits: N/A
Permits:	MONTGOMERY COUNTY	Jurisdiction: 4501 Tree: N/A
WSSC:	16PS003	Easement: N/A
WR #	3504248	Date: 2/1/2017